


NOTES:

1. THE DISTRICT'S PORTION OF ALL SEWER SERVICE LATERALS SHALL BE A MIN. OF 6-INCHES.
2. NO MORE THAN TWO (2) RESIDENTIAL UNITS ARE ALLOWED TO TIE INTO A SINGLE 6-INCH SERVICE LATERAL.
3. A MIN. 6-INCH LATERAL SHALL BE PROVIDED FOR ANY APARTMENT BUILDING, COMMERCIAL BUSINESS, OR INDUSTRIAL APPLICATION.
4. A 1.04% MIN. SLOPE ($\frac{1}{8}$ " PER FOOT) IS REQUIRED FOR SERVICE LATERALS, HOWEVER 2.0% IS RECOMMENDED. FLATTER SLOPES FOR SERVICE LATERAL LINES, LESS THAN 1.04%, BUT GREATER THAN 0.50% WILL BE REVIEWED ON A CASE-BY-CASE BASIS.
5. INSTALL 3-IN. METALLIC WARNING TAPE 18-INCHES ABOVE MAINS AND SERVICES.

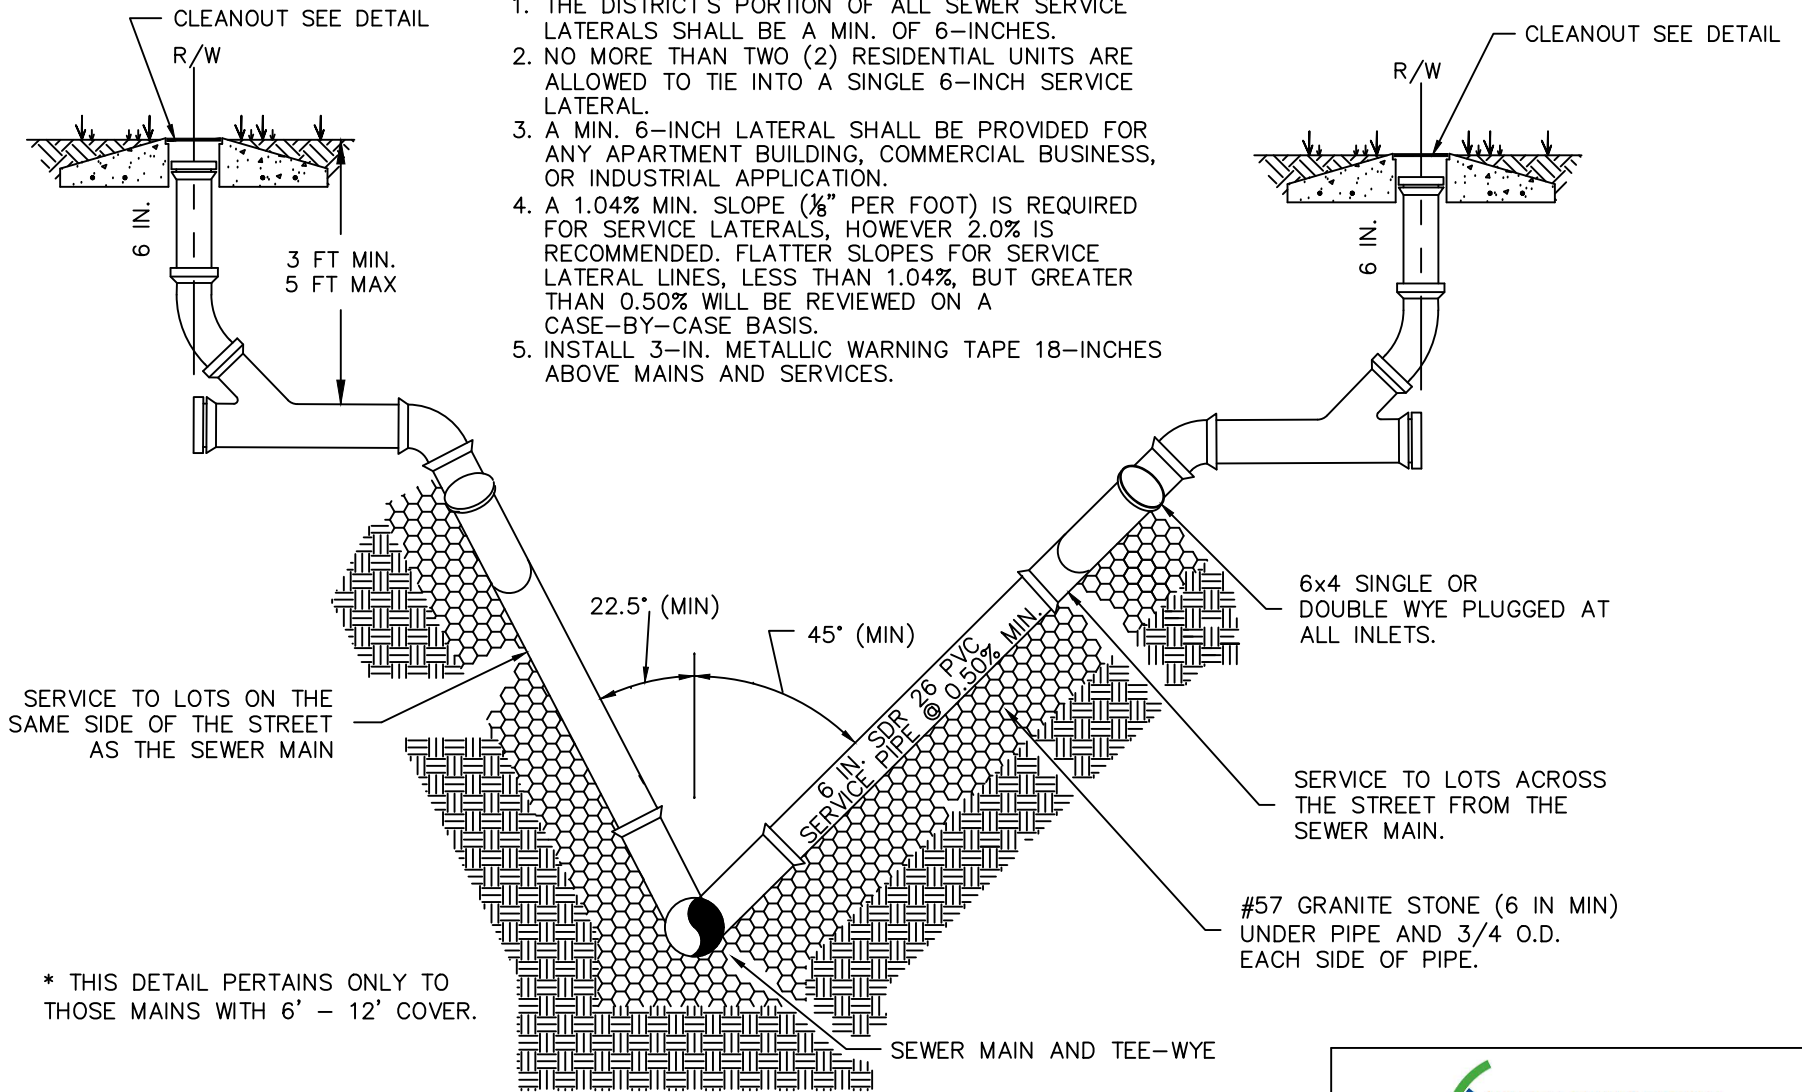

SERVICE TO LOTS ON THE SAME SIDE OF THE STREET AS THE SEWER MAIN

6x4 SINGLE OR DOUBLE WYE PLUGGED AT ALL INLETS.

SERVICE TO LOTS ACROSS THE STREET FROM THE SEWER MAIN.

#57 GRANITE STONE (6 IN MIN) UNDER PIPE AND 3/4 O.D. EACH SIDE OF PIPE.

* THIS DETAIL PERTAINS ONLY TO THOSE MAINS WITH 6' - 12' COVER.

SEWER MAIN AND TEE-WYE

**TYPICAL DEEP SEWER SERVICE
CONSTRUCTION DETAIL**
N.T.S.



7255 STALL ROAD, NORTH CHARLESTON, SC 29406
PH: (843) 764-3072 FAX: (843) 764-2655

N.C.S.D. STANDARD DETAILS

REV. DATE: JUNE 2019 DWG#: GS-009