


GENERAL NOTES:

1. THE PUMP STATION SITE SHALL BE LOCATED ON A PLATTED PARCEL OF 50 FEET BY 50 FEET AREA TO BE OWNED BY N.C.S.D.
3. PROVIDE HEAVY DUTY ASPHALT PAVEMENT PER APPLICABLE SITE GEOTECHNICAL REPORT, OR IF NO GEOTECHNICAL REPORT IS AVAILABLE THE SITE PAVING SHALL CONFORM TO CURRENT SCDOT HEAVY DUTY PAVEMENT SPECIFICATIONS.
4. THE PUMP STATION SITE SHALL BE GRADED TO PROMOTE POSITIVE DRAINAGE AWAY FROM THE WETWELL TO OFFSITE AN OFFSITE DRAINAGE SYSTEM. PERMANENT EROSION CONTROL METHODS SHALL BE IN PLACE TO PROTECT PUMP STATION FEATURES AND ASPHALT FOUNDATION.
5. EMERGENCY GENERATOR: MUST MEET MINIMUM SPECIFICATIONS. FINAL BRAND APPROVED BY N.C.S.D.
6. COAT INTERIOR OF WET WELL W/ LEVEL C EPOXY LINING SYSTEM, MIN. 250 MILS THICKNESS, OR AS DETERMINED BY ENGINEER.

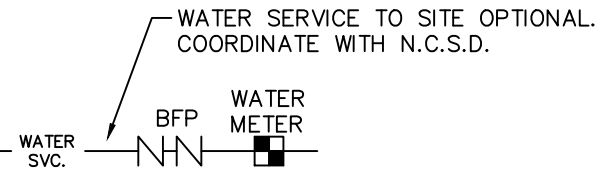

LEGEND

- SS SANITARY SEWER
- UGE UNDERGROUND ELECTRIC
- W WATER SERVICE
- FM SEWER FORCE MAIN

TYPICAL PUMP STATION SITE PLAN

ARRANGEMENT MAY VARY DUE TO SITE CONDITIONS

N.T.S.



7255 STALL ROAD, NORTH CHARLESTON, SC 29406
 PH: (843) 764-3072 FAX: (843) 764-2655

N.C.S.D. STANDARD DETAILS

REV. DATE: JUNE 2019 | DWG#: | PS-003